

MA KOI

pond filtration


Extra information for Biodrumrotators.

The helix will settle in due to transport. Our advice is to fill the rotator, for the best effect, the biological material must remain still, it must not move.

Biodrum Rotator 40:



Biodrum Rotator 50/80:

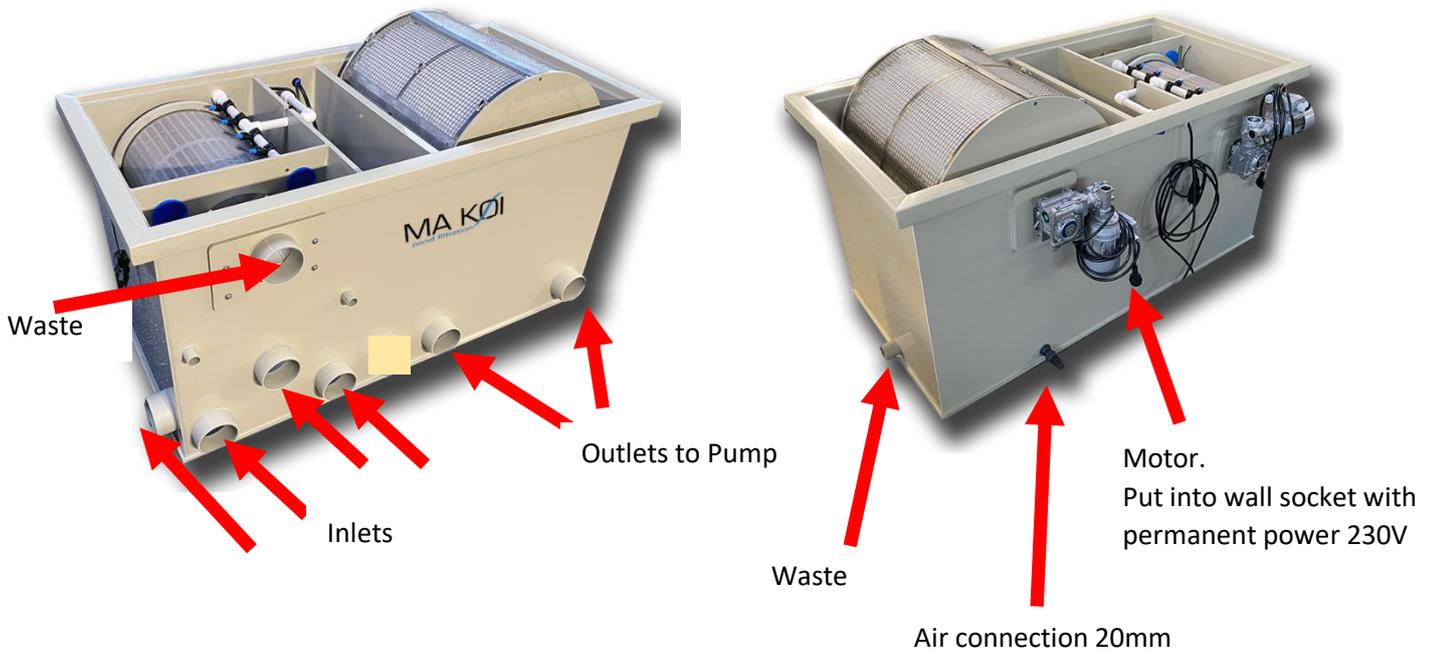



Drum motor to electronics

Flushing pump to electronics



Drum Motor

Flushing pump

Pond pump

Drum Motor

Flushing pump

Pond pump



Caution:

Don't put the lid from rotator when the rotator motor is on. This can cause injury! Always unplug the electrics when the lid will be taken of.

