
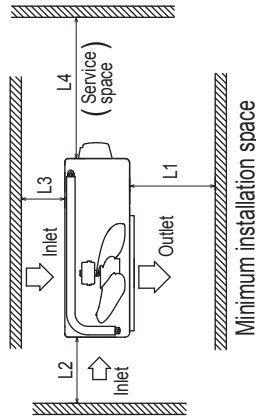


## 1.2 Exterior dimensions Models SCM50ZS-W, 60ZS-W


### Notes

- (1) The unit must not be surrounded by walls on the four sides.
- (2) The unit must be fixed with anchor bolts. An anchor bolt must not protrude more than 15mm.
- (3) If the unit is installed in the location where there is a possibility of strong winds, place the unit such that the direction of air from the outlet gets perpendicular to the wind direction.
- (4) Leave 200mm or more space above the unit.
- (5) The wall height on the outlet side should be 1200mm or less.
- (6) The model name label is attached on the right side of the unit.

Symbol	Content
A	Service valve connection (gas side) φ9.52(3/8") (Flare)
B	Service valve connection (liquid side) φ6.35(1/4") (Flare)
C	Pipe / cable draw-out hole
D	Drain discharge hole φ20×2places
E	Anchor bolt hole M10-12×4places

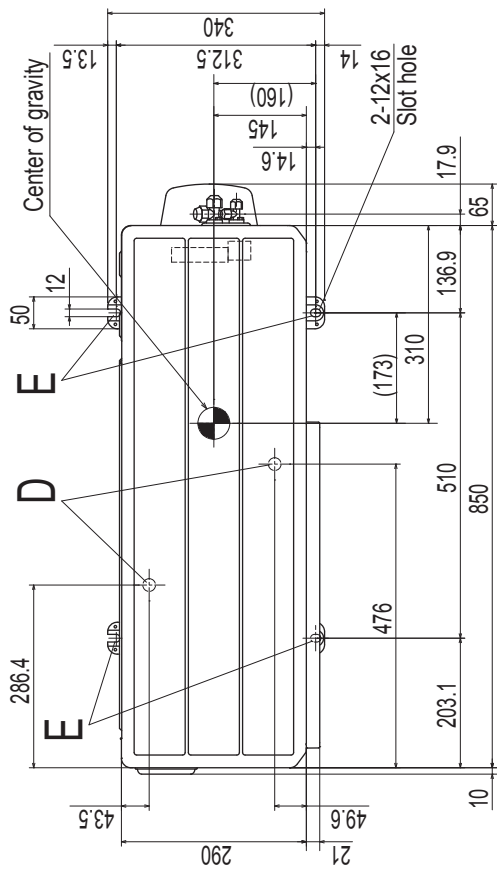

Installation space	Minimum installation space
L1	600 or more
L2	100 or more
L3	100 or more
L4	No obstacles (Service space or electrical parts)

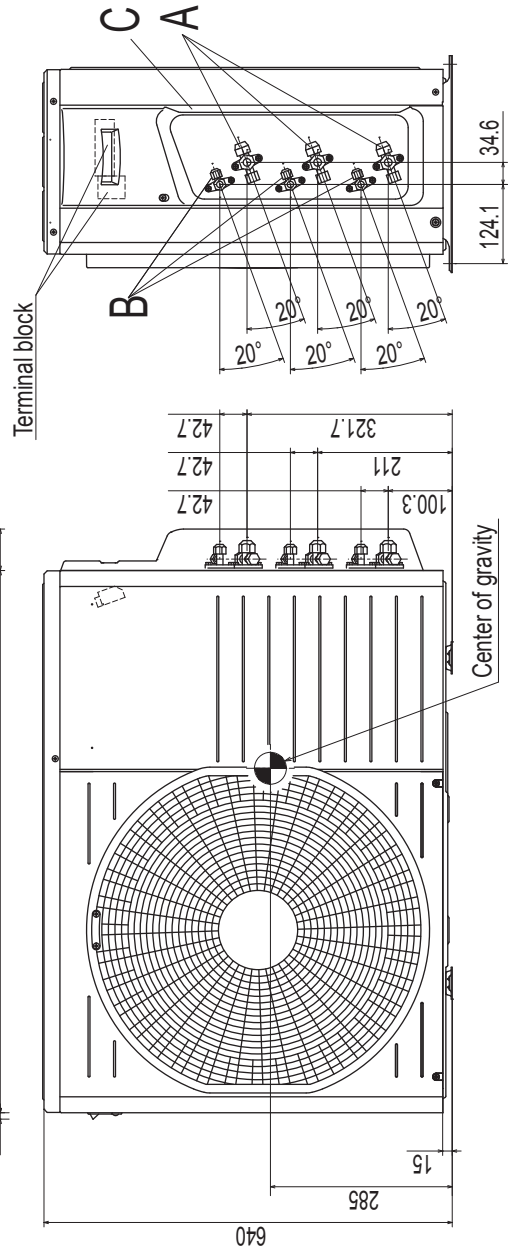

Unit:mm

RWC000Z332